


Instrucciones de instalación / Mounting instructions:

Conexionado / Connection


	Tamaño D1 / Size D1		Tamaño D2 / Size D2	
	25A	40A	63A	125A
tornillos / connect. screws	M4	M5	M8	M8
par de apriete /torque Nm	1,6	2,0	3,5	3,5
terminal				
Sección cable flexible flexible wire section mm²	2,5-6	6-16	16-50	16-50

Dimensiones / Dimensions




2IN

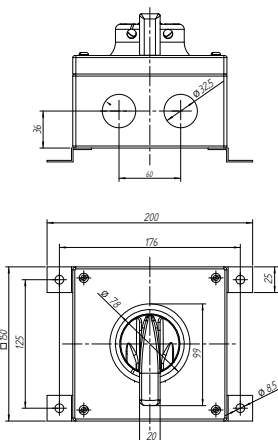

3IN

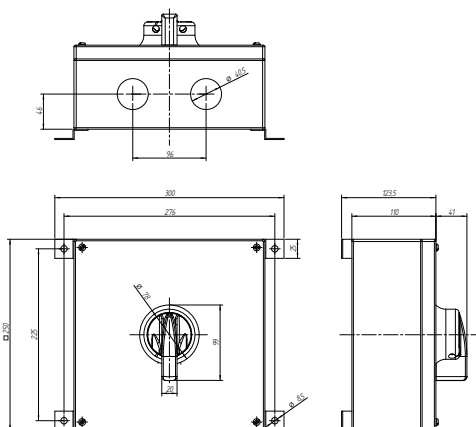

Cableado / Wiring

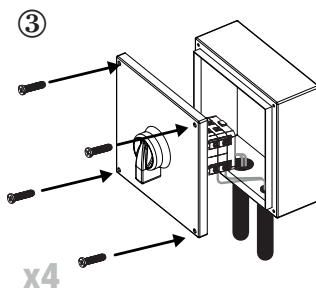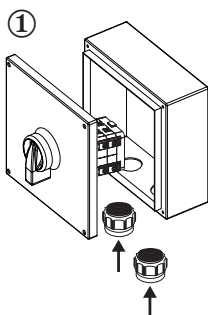


x4

Esquemas / Diagrams


552 Interruptor 3P / 3P switch

5	6	X
3	4	X
1	2	X
552	0	1




553 Interruptor 4P / 4P switch

7	8	X
5	6	X
3	4	X
1	2	X
553	0	1




556 Interruptor 6P / 6P switch


11	12	X
9	10	X
7	8	X
5	6	X
3	4	X
1	2	X
556	0	1



Mando de seguridad / Padlockable handle

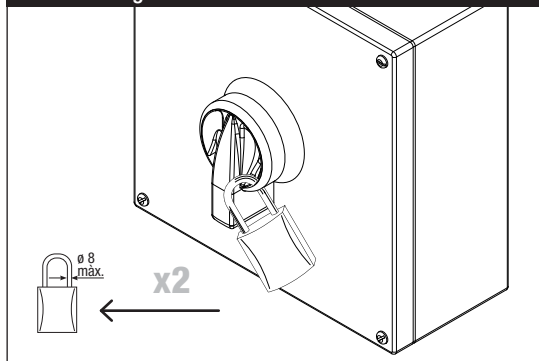

Fijación mural / Wall fixing

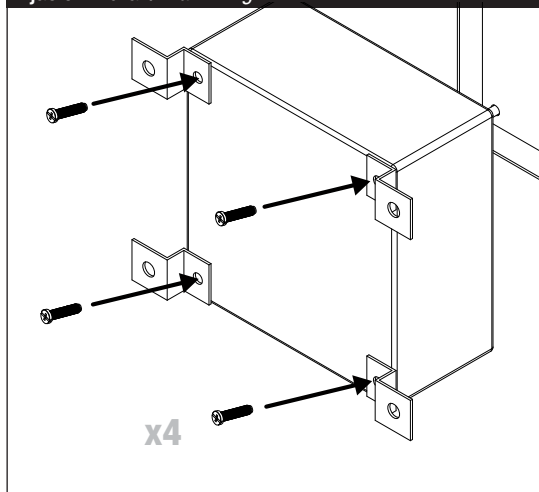

Conforme a las normas / According to standards:

IEC 60947-1/3

EN60529

EN1672-2

⚠ PELIGRO / DANGER

TENSIÓN PELIGROSA Únicamente el personal de mantenimiento eléctrico especializado deberá instalar y prestar servicios de mantenimiento a este equipo. Cortar la alimentación del equipo antes de realizar cualquier trabajo en él. Utilice siempre un dispositivo detector de tensión adecuado para confirmar la falta de tensión en el equipo. Vuelva a colocar todos los dispositivos, las puertas y las cubiertas antes de poner el equipo en tensión. El incumplimiento de estas precauciones podrá causar la muerte o lesiones graves.

HAZARDOUS VOLTAGE This equipment must be installed and serviced only by qualified electrical personnel. Turn off all power supplying this equipment before working on or inside equipment. Always use a properly rated voltage sensing device to confirm power is off. Replace all devices, doors, and covers before turning on power to this equipment. Failure to follow these instructions will result in death or serious injury.